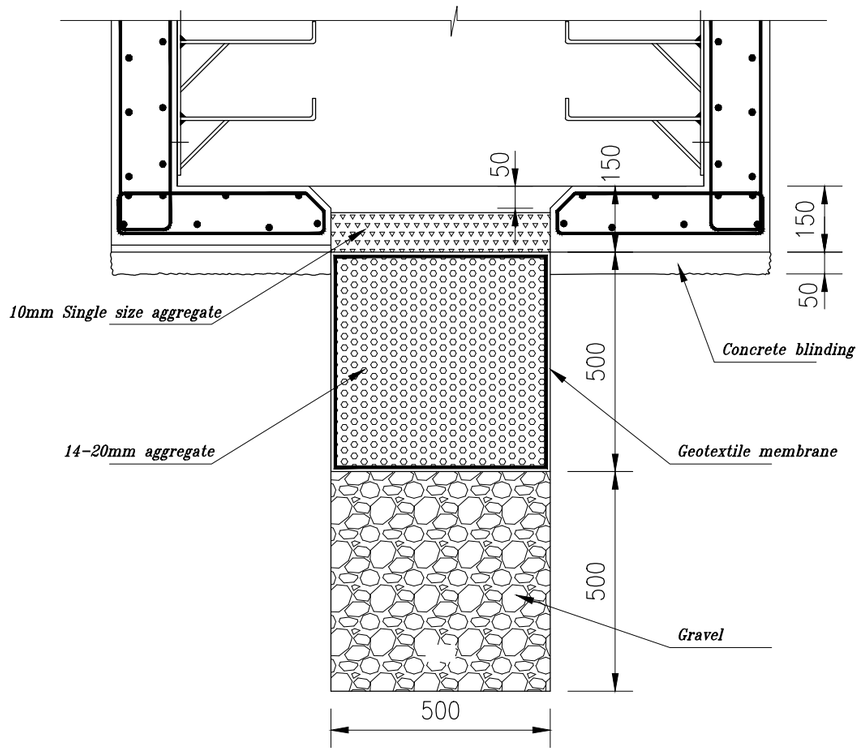

TYPICAL SOAKAGE PIT DETAIL IN CABLE DUCT

SOAKAGE PIT TO BE POSITIONED AT EVERY 3m IN ALL CABLE DUCTS.

PRELIMINARY

CENTRAL ELECTRICITY BOARD				
Central Electricity Board	Rev. A	Date: 25.09.2019	TITLE: RODRIGUES Mw SOLAR PLANT - SOAKAGE PIT DETAILS	
	Rev. B	Drawn: J.M		
	Rev. C	Chkd: M.P.N		
	Rev. D			
	Rev. E	Appd: LOTHUN	Scale: 1:20	DRAWING No. 6766-19